



HP-1 THRU HP-53 SPECIFICATION



FOR INDOOR OR OUTDOOR FRESH AND SALT
WATER APPLICATIONS

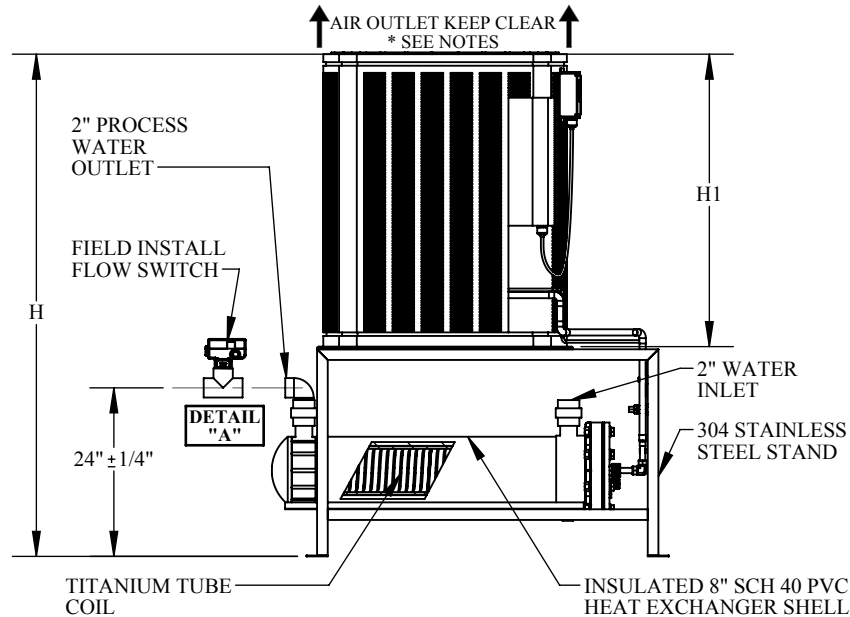

FRONT VIEW

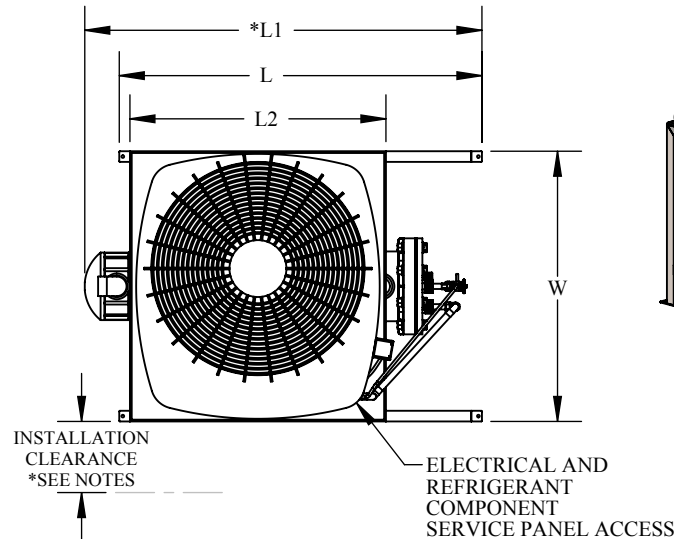

PLAN VIEW

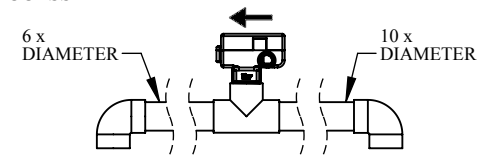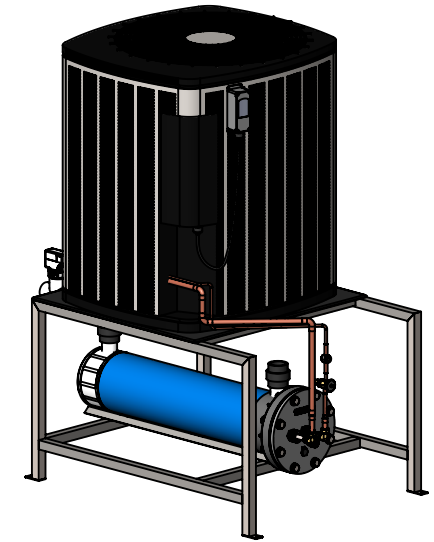

IMPORTANT! DETAIL "A"

· FLOW SWITCH MUST BE FIELD INSTALLED HORIZONTALLY WITH NO LESS THAN 10 TIMES THE DIAMETER OF STRAIGHT PIPE ON THE INLET SIDE AND NO LESS THAN 6 TIMES THE DIAMETER ON THE OUTLET SIDE.

OPTIONS:

- SCH 80 SHELL CONSTRUCTION.
- 316 STAINLESS STEEL STAND AND HARDWARE.
- LOW AMBIENT HEAD PRESSURE CONTROL ON COOLING MODE ONLY.
- COASTAL MARINE CONDENSER COATING.

TITAN HEAT PUMPS												
MODEL NO.	NOMINAL TONS / BTUH / KW	VOLTS / PHASE	AMPS RLA / LRA	WATER FLOW RATE (GPM)	*AIR OUTLET (CFM)	H	H1	L	*L1	L2	W	SHIPPING WEIGHT (LBS.)
HP-1	1.5 / 18K / 5.2	208-240 / 1	6 / 38	20 / 40	1550	59"	29"	44"	n/a	31"	33"	406
HP-2	2 / 24K / 7	208-240 / 1	8.7 / 57	20 / 40	1550	63"	33"	44"	n/a	31"	33"	389
HP-3	3 / 36K / 10.5	208-240 / 1	14 / 91	20 / 40	2175	63"	33"	51"	n/a	36"	38"	500
HP-33	3 / 36K / 10.5	208-240 / 3	10.9 / 74	20 / 40	2175	63"	33"	51"	n/a	36"	38"	495
HP-33-460	3 / 36K / 10.5	460 / 3	5.5 / 38	20 / 40	2175	63"	33"	51"	n/a	36"	38"	495
HP-4	4 / 48K / 14	208-240 / 1	18.6 / 94	30 / 60	2500	67"	37"	51"	n/a	36"	38"	518
HP-43	4 / 48K / 14	208-240 / 3	13.7 / 101	30 / 60	2500	67"	37"	51"	n/a	36"	38"	515
HP-43-460	4 / 48K / 14	460 / 3	7.1 / 51	30 / 60	2500	67"	37"	51"	n/a	36"	38"	515
HP-5	5 / 60K / 17.5	208-240 / 1	25 / 148	30 / 60	3700	75"	45"	51"	56"	36"	38"	553
HP-53	5 / 60K / 17.5	208-240 / 3	18.6 / 139	30 / 60	3700	75"	45"	51"	56"	36"	38"	538
HP-53-460	5 / 60K / 17.5	460 / 3	9 / 71	30 / 60	3700	75"	45"	51"	56"	36"	38"	538

*NORMAL OPERATING AMBIENT AIR TEMPERATURE: 50°F - 115°F.

*ADD LOW AMBIENT HEAD PRESSURE CONTROL FOR OPERATING IN AMBIENT AIR TEMPERATURES FROM 0°F TO 50°F.
CONSULT AQUA LOGIC IF OPERATING AT TEMPERATURES OUTSIDE THESE RANGES.

*ALL CONDENSING UNITS HAVE A 14 SEER RATING.

*L1 DIMENSION ARE FOR MODELS HP-5 & HP-53 CHILLERS.

*NOTES:

- TOP DISCHARGE AREA SHOULD BE UNRESTRICTED FOR 60 INCHES MINIMUM.
- UNIT SHOULD BE PLACED SO ROOF RUN-OFF WATER DOES NOT POUR DIRECTLY ON UNIT.
- RECOMMENDED CLEARANCE FOR PROPER OPERATION AND MAINTENANCE IS 24" FROM WALLS, SHRUBBERY, FENCES, ETC.
- MINIMUM CLEARANCE BETWEEN ADJACENT UNITS IS 72 INCHES.
- ALL DIMENSIONS ARE APPROXIMATE AND CAN CHANGE AT ANY TIME.



9558 Camino Ruiz
San Diego, CA 92126

DRAWING #
PDF-0237

SHEET TITLE

HP-1 THRU HP-53
SPECIFICATIONS

* COPYRIGHT *
These drawings including design idea
and construction techniques herein are the
sole property of Aqua Logic Inc. They shall
not be revised, copied, or reproduced in any
manner without the written consent of
Aqua Logic Inc.

DESCRIPTION
TITAN HEAT PUMP AIR COOLED

DRAWN BY

DATE

REVISION

SCALE

SHEET #

ARNALDO GUZMAN

3/18/2015

1:27

1 OF 1